

## 2.1. STANDART + - U=0.164 с ВЪНШНА МАЗИЛКА

### Moisture proofing

For the calculation of the amount of condensation water, the component was exposed to the following constant climate for 90 days: inside: 20°C und 60% Humidity; outside: -20°C und 80% Humidity (Climate according to user input).

This component is free of condensate under the given climate conditions.


Drying reserve according to Ubakus 2D-FE method: 319 g/(m<sup>2</sup>a)  
At least required by DIN 68800-2: 100 g/(m<sup>2</sup>a)

#	Material	sd-value [m]	Condensate [kg/m <sup>2</sup> ] [Gew.-%]	Weight [kg/m <sup>2</sup> ]
1	1,25 cm Gypsum board	0,05	-	8,5
2	1,25 cm Gypsum board	0,05	-	8,5
3	3 cm Stationary air (unventilated)	0,01	-	0,0
	3 cm Spruce (7,0%)	0,60	-	0,9
4	0,05 cm Vapor barrier sd=35m	35,00	-	0,1
5	10,5 cm mineral wool 035	0,11	-	2,0
	10,5 cm Spruce (7,0%)	2,10	-	3,3
6	1,5 cm OSB/3	2,25	-	9,3
7	10 cm mineral wool 035	0,10	-	2,0
8	0,5 cm Cement plaster	0,18	-	10,0
	28,05 cm Whole component	37,87		44,7

### Humidity

The temperature of the inside surface is 18,1 °C leading to a relative humidity on the surface of 68%. Mould formation is not expected under these conditions.

The following figure shows the relative humidity inside the component.

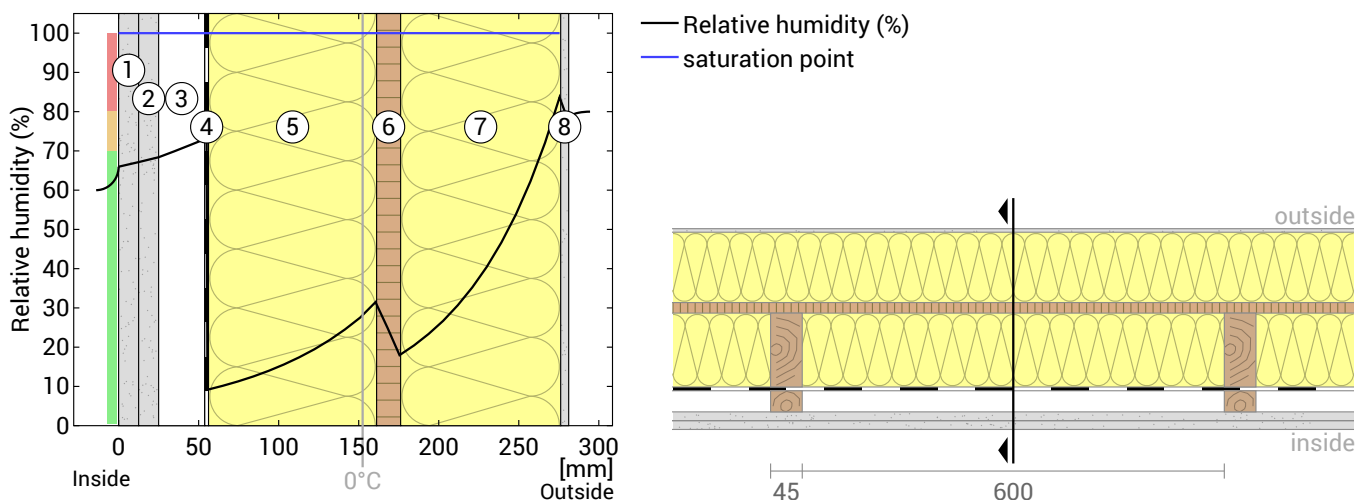

- |                          |                             |                             |
|--------------------------|-----------------------------|-----------------------------|
| ① Gypsum board (12,5 mm) | ④ Vapor barrier sd=35m      | ⑦ mineral wool 035 (100 mm) |
| ② Gypsum board (12,5 mm) | ⑤ mineral wool 035 (105 mm) | ⑧ Cement plaster (5 mm)     |
| ③ Stationary air (30 mm) | ⑥ OSB/3 (15 mm)             |                             |

Notes: Calculation using the Ubakus 2D-FE method. Convection and the capillarity of the building materials were not considered. The drying time may take longer under unfavorable conditions (shading, damp / cool summers) than calculated here.